# **5** Simplex

# True Alert Multi-Candela Notification Appliances

UL, ULC, CSFM Listed; FM Approved; MEA (NYC) Acceptance\*

Visible Notification Appliances with Speaker and Multi-Candela Strobe: Non-Addressable

#### **Features**

Speaker/visible (S/V) notification appliances with multi-tapped speaker and multi-tapped high intensity xenon strobe with synchronized flash:

- Rugged, high impact, flame retardant thermoplastic housings are available for wall or ceiling mount
- Operation is compatible with ADA requirements (refer to important wall mount installation information on page 4)

#### Wall mount S/V features:

- Housings are available in red or white with clear lens with contrasting white or red "FIRE" lettering
- Covers are available separately to convert housing color

#### Ceiling mount S/V features:

- · Housing is white with clear lens
- Red "FIRE" lettering is printed on two sides

### Audible notification appliance (speaker):

- High quality voice and tone reproduction with taps for  $\frac{1}{4}$ ,  $\frac{1}{2}$ , 1, or 2 W, at 25 or 70.7 VRMS
- Capacitor input for connection to supervised notification appliance circuits
- Speakers are wired separately from strobe wiring
- UL listed to Standard 1480 and ULC-S541\*
- Compliant with NFPA 72, 520 Hz Low Frequency Signal Requirements for Sleeping Areas


#### Visible notification appliance (strobe):


- 24 VDC xenon strobe; intensity is selectable as 15, 30, 75, or 110 candela with visible selection jumper secured behind strobe housing
- Strobes are activated from NACs selected to provide Simplex<sup>®</sup> strobe synchronization signals or from separate strobe Synchronization Modules that are available for Class B or Class A operation
- Regulated circuit design ensures consistent flash output and provides controlled inrush current
- UL listed to Standard 1971 and ULC-S526\*

#### Options for wall mounted S/Vs:

- Red or white adapters to cover surface mounted electrical boxes
- Red adapter for mounting to Simplex 2975-9145 boxes
- · Red wire guard







Wall and Ceiling Mount S/Vs

### Description

Multi-Candela TrueAlert S/Vs with speaker and synchronized strobe provide convenient installation to standard electrical boxes with extensions. The enclosure designs are both impact and vandal resistant and provide a convenient strobe intensity selection. Since each model can be selected for strobe intensity output, on-site model inventory is minimized and changes encountered during construction can be easily accommodated.

**Wall mount** S/V housings are a one-piece assembly (including lens) that mounts to a 4" square electrical box with extension (see details on page 4). The cover can be quickly removed (a tool is required) and covers are available separately for color conversion.

**Ceiling mount** S/Vs also install using 4" electrical boxes with an extension (see details on page 4).

#### Strobe Intensity Selection

During installation, a selection plug at the back of the housing determines the desired strobe intensity. An attached flag with black letters on a highly visible yellow background allows the selected intensity to be seen at the side of the strobe lens.

See page 2 for additional listing details and wire guard listings. This product has been approved by the California State Fire Marshal (CSFM) pursuant to Section 13144.1 of the California Health and Safety Code. See CSFM Listing 7320-0026:247 for allowable values and/or conditions concerning material presented in this document. Accepted for use – City of New York Department of Buildings – MEA35-93E. Additional listings may be applicable; contact your local Simplex product supplier for the latest status. Listings and approvals under Simplex Time Recorder Co. are the property of Tyco Fire Protection Products.

# Synchronized Strobes

**Multiple Strobes.** When multiple strobes and their reflections can be seen from one location, synchronized flashes reduce the probability of photo-sensitive reactions as well as the annoyance and possible distraction of random flashing. The multi-candela strobes of these S/Vs are activated by NACs that provide the Simplex synchronization format. For additional information, refer to data sheet S4905-0003.

# **Strobe Application Selection**

Proper selection of visible notification is dependent on occupancy, location, local codes, and proper applications of: the *National Fire Alarm and Signaling Code* (NFPA 72), ANSI A117.1; the appropriate model building code: BOCA, ICBO, or SBCCI; and the application guidelines of the Americans with Disabilities Act (ADA).

### **Product Selection**

#### Wall Mount Multi-Candela S/Vs

Model	Housing Color	"FIRE" Lettering	Listings	Description	Housing Dimensions with Lens	
4906-9151	Red	White	111 8 111 6	Multi-tapped Speaker with Multi-Candela	7 ¼" H x 5" W x 2 %" D	
4906-9153	White	Red	UL & ULC	Synchronized Strobe; strobe intensity selectable as: 15, 30, 75, or 110 candela	(184 mm x 127 mm x 67 mm)	

#### Ceiling Mount Multi-Candela S/V

Model	Housing Color	"FIRE" Lettering	Listings	Description	Dimensions
4906-9154	White	Red	UL	Multi-tapped Speaker with Multi-Candela	Housing = 7 ½" (191 mm) diameter, ½" (13 mm) deep
4906-9157	White	Red	ULC	Synchronized Strobe; strobe intensity selectable as: 15, 30, 75, or 110 candela	Strobe lens protrusion = 2 5%" (67 mm) above speaker housing Depth into box = 2 3/4" (70 mm)

#### Wall Mount S/V Adapters

Model	Description	Dimensions			
4905-9946	Surface mount red adapter skirt	Required when mounting to surface mounted electrical box, 4" square,	7 ¾" H x 5 ¾" W x 3 ¾ <sub>6</sub> " D (197 mm x 137 mm x 81 mm)		
4905-9947	Surface mount white adapter skirt	1 ½" deep with 1 ½" deep extension	depth with S/V = 5 1/8" (149 mm)		
4905-9903	Adapter Plate, red, required to moun	8 <sup>5</sup> / <sub>16</sub> " H x 5 <sup>3</sup> / <sub>4</sub> " W x 0.060" Thick (211 mm x 146 mm x 1.5 mm)			
2975-9145	Mounting box, red, for surface or flush mount, requires adapter plate 4905-9903 (this box may be available for retrofit applications)		7 1/8" H x 5 1/8" W x 2 3/4" D (200 mm x 130 mm x 70 mm)		

### **Wall Mount S/V Replacement Covers**

Model	Description	Dimensions
4905-9996	Red S/V cover with white "FIRE" lettering	7 ¼" H x 5" W x 1 ¾" D
4905-9997	White S/V cover with red "FIRE" lettering	(184 mm x 127 mm x 35 mm)

#### **Synchronized Flash Control Modules**

Model	Description	Dimensions			
4905-9914*	Synchronized Flash Module, Class B operation	Epoxy encapsulated with in/out 18 AWG (0.82 mm²) wire leads,	1 %" W x 2 <sup>7</sup> ⁄ <sub>16</sub> " L x <sup>13</sup> ⁄ <sub>16</sub> " H		
4905-9922*	Synchronized Flash Module, Class A operation	rated for 2 A NAC, requires 5 mA for power	(35 mm x 62 mm x 20 mm)		

#### Wall Mount S/V Wire Guard

Model	Description	Dimensions
4905-9998	Wire guard with mounting plate, red, compatible with surface and semi-flush boxes (UL listed by Space Age Electronics Inc.)	8 %" H x 6 ½6" W x 3 ¼" D (213 mm x 154 mm x 79 mm)

#### **Ceiling Mount Tile Bridge**

Model	Description	Dimensions
2905-9946	Tile Bridge	See diagram on page 4

<sup>\*</sup> Refer to data sheet S4905-0003 for additional flash control module information

# S/V Specifications

C	Enviro	onmental 32° to	122° F (0° 1	o 50° C); 10% to 93%,	non-conder	nsing at 100°	F (38° C)			
Common Specificat									/out wiring	
Speaker	Specification				(0.02	,			<u>-</u>	
Input Volt	-			25 or 70.7 VRMS, se	e Note 1 bel	OW				
Power Ta	ps			1/4, 1/2, 1, and 2 W						
Erogueno	y Response		Fire Alarm	400 to 4000 Hz						
Frequenc	y Response	Genera	Signaling	125 to 12 kHz						
				W	/attage Tap	1/4 W	½ W	1 W	2 W	
		UL Listed Mode	els, Reverb	erant Chamber Test, p	er UL 1480	76 dBA	79 dBA	82 dBA	85 dBA	
Speaker Output Ratings @ 10 ft (3 m) (see Note 1 below)		W		Todels <b>4906-9151</b> and <b>4906-9153</b> , noic Chamber Test, per ULC-S541		77 dBA	80 dBA	83 dBA	86 dBA*	
(500 11010	1 below)	Ceiling Mou	nt Model <b>49</b>	0 <b>6-9157</b> . 25 \	/RMS Input	81.6 dBA	84.3 dBA	87.1 dBA*	89.7 dBA*	
		3		JLC-S541 70.7 VRMS Input		80.9 dBA	84.1 dBA	87.3 dBA*	90.2 dBA*	
* NOTE: S	Select taps as	indicated to satis	fy the ULC	fire alarm applications	requirement	t of 85 dBA m	ninimum	•	•	
Polar Disp	persion Refere	ence (per ULC-S5	41	Attenuation	Ang	gle	Attenuatio	Attenuation		
	Chamber Tes			-3 dB	+/- 30°	+/- 30° off-axis		-6 dB +/- 5		
Strobe S	Specification	ns						•		
Rated Vol	tage Range			Regulated 24 VDC; 1	6 VDC to 33	VDC, see N	lote 2 below			
Flash Rat	e and Synchro	onized NAC Load	ing	1 Hz; with up to 35 synchronized strobes maximum per NAC						
	Housing Dim	nensions (with len	s)	7 ¼" H x 5" W x 2 5/8" D (184 mm x 127 mm x 67 mm)						
	Maximum RMS Current Rating per			15 cd	30 cd		75 cd		110 cd	
Wall Mount	Strobe Settir	Strobe Setting		60 mA	94 n	nA	186 mA	2	252 mA	
mount	Reference RMS Currents at other voltages 18 VDC 24 VDC		18 VDC	53 mA	84 mA		165 mA 2		24 mA	
			40 mA	63 mA		124 mA		68 mA		
	Housing Dimensions			Speaker housing = $7 \frac{1}{2}$ " (191 mm) diameter, $\frac{1}{2}$ " deep (13 mm); lens protrusion above speaker housing = $2 \frac{5}{6}$ " (67 mm); depth into box = $2 \frac{3}{4}$ " (70 mm)						
Ceiling	Maximum RMS Current Rating per		15 cd	30 cd		75 cd 1		110 cd		
Mount	Strobe Setting			75 mA	125 ו	mA	233 mA	3	16 mA	

#### NOTES:

Speakers are for connection to conventional fire alarm audio circuits. Anechoic speaker output ratings are typically more representative
of actual installed sound output.

111 mA

83 mA

207 mA

155 mA

67 mA

50 mA

2. The maximum RMS strobe current listed is the device nameplate rating. Strobe designs are constant wattage and the maximum RMS current rating occurs at the lowest allowable operating voltage. (RMS is root mean square and refers to the effective value of a varying current waveform.)


# **Speaker Directional Characteristics Reference**

Reference RMS Currents at

other voltages

18 VDC


24 VDC

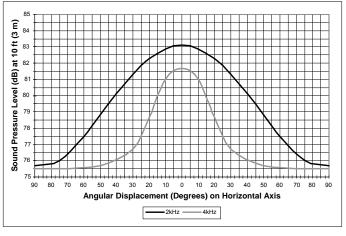


281 mA


211 mA


## Ceiling Mount S/V Installation Reference and Tile Bridge Dimensions

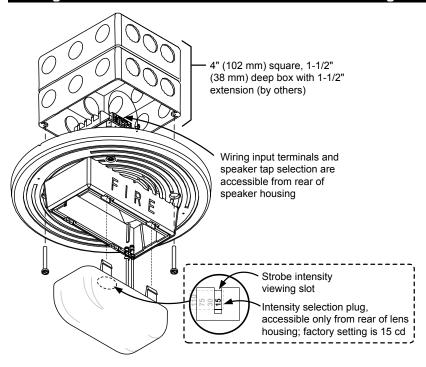


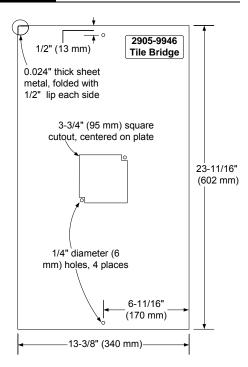

# **Wall Mount Installation Reference**

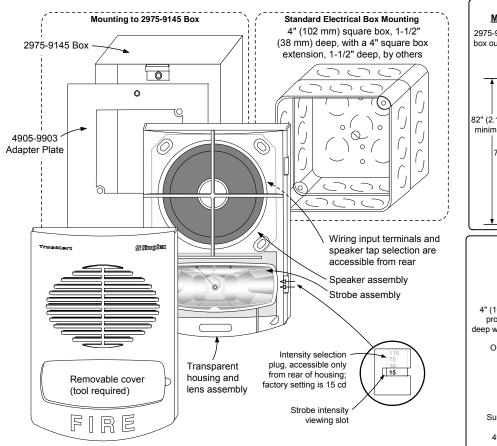





TYCO, SIMPLEX, and the product names listed in this material are marks and/or registered marks. Unauthorized use is strictly prohibited. NFPA 72 and National Fire Alarm and Signaling Code are registered trademarks of the National Fire Protection Association (NFPA).